

NOTES THIS SHEET


- 1 CONNECT NEW COLD WATER TO EXISTING 1-1/2" CW. VERIFY EXACT LOCATION AND SIZE.
- 2 CONNECT NEW 4" WASTE TO EXISTING CLEANOUT. EXISTING INVERT ESTIMATED AT 94'-0". VERIFY.
- 3 CONNECT 1" CONDENSATE DRAIN TO FC-UNIT. EXTEND DOWN IN WALL AND DISCHARGE TO FD-1.
- 4 NEW RAIN DRAIN. CONNECT TO EXISTING SITE RAIN DRAIN. COORDINATE WITH CIVIL SITE UTILITY.
- 5 CONNECT TO DOWNSPOUT. SEE 3/P.0.1.
- 6 EXTEND AND CONNECT 3/4" CW TO CHILLER MAKE-UP WATER. SEE 2/3.1.
- 7 1/2" DOWN WALL TO TRAP PRIMER LOCATION. EXTEND PRIMER PIPING UNDERSLAB TO FLOOR DRAINS IN BATTERY ROOM 105.
- 8 AREA AROUND P-1,2 TO BE CURBED. INSTALL CURB MIN. 12" FROM PUMP FRAME. INSTALL FD-1 INSIDE CURB. PROVIDE LEAK DETECTION AROUND FD. COORDINATE WITH ARCHITECT. LEAK DETECTION ALARM TO BE MOUNTED IN CONTROL ROOM. COORDINATED WITH OWNER. CURB TO BE 8" HIGH COORDINATE WITH ARCHITECTURAL DRAWINGS

1 PROPOSED PHASE II AND III FLOOR PLAN - PLUMBING
 MI SCALE: 1/8" = 1'-0"

GROUP MACKENZIE
 Architecture
 Interior Design
 Land Use Planning
 Civil Engineering
 Structural Engineering
 Transportation Planning
 0690 SW Bancroft St / PO Box 6039
 Portland, OR 97201-0039
 Tel: 503.224.9540 / 360.695.7879
 Fax: 503.228.2825



Project
BROADBAND FACILITY EXPANSION PHASE 2 and 3
 Troutdale Oregon

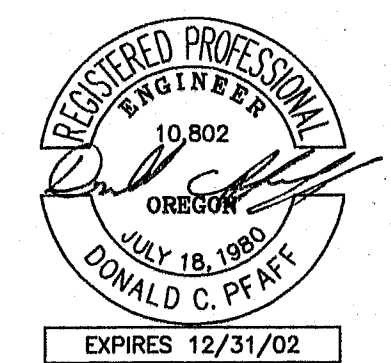

© GROUP MACKENZIE 2002
 ALL RIGHTS RESERVED
 THESE DRAWINGS ARE THE PROPERTY OF GROUP MACKENZIE AND ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, WITHOUT PRIOR WRITTEN PERMISSION

REVISIONS:

REVISION	DATE	REVISION	EDITION
A	7/30/02		
B	8/12/02		
C	9/13/02		

SHEET TITLE:
PHASE II AND III FLOOR PLAN PLUMBING

FIRST ISSUED:
 LAST ISSUED: 7/03/02
 DRAWN BY: MDJ

CHECKED BY: DCP
 SHEET:

P2.1

JOB NO. **990276**



INCLUDING REVISION C ISSUED FOR BID 7/03/02